


NOTE - THIS DRAWING TO BE READ IN CONJUNCTION WITH: -

- Drg Nos 170717/M/01 - 03 & 170717/E/01 - 04
- M&E Services Schedule of Work

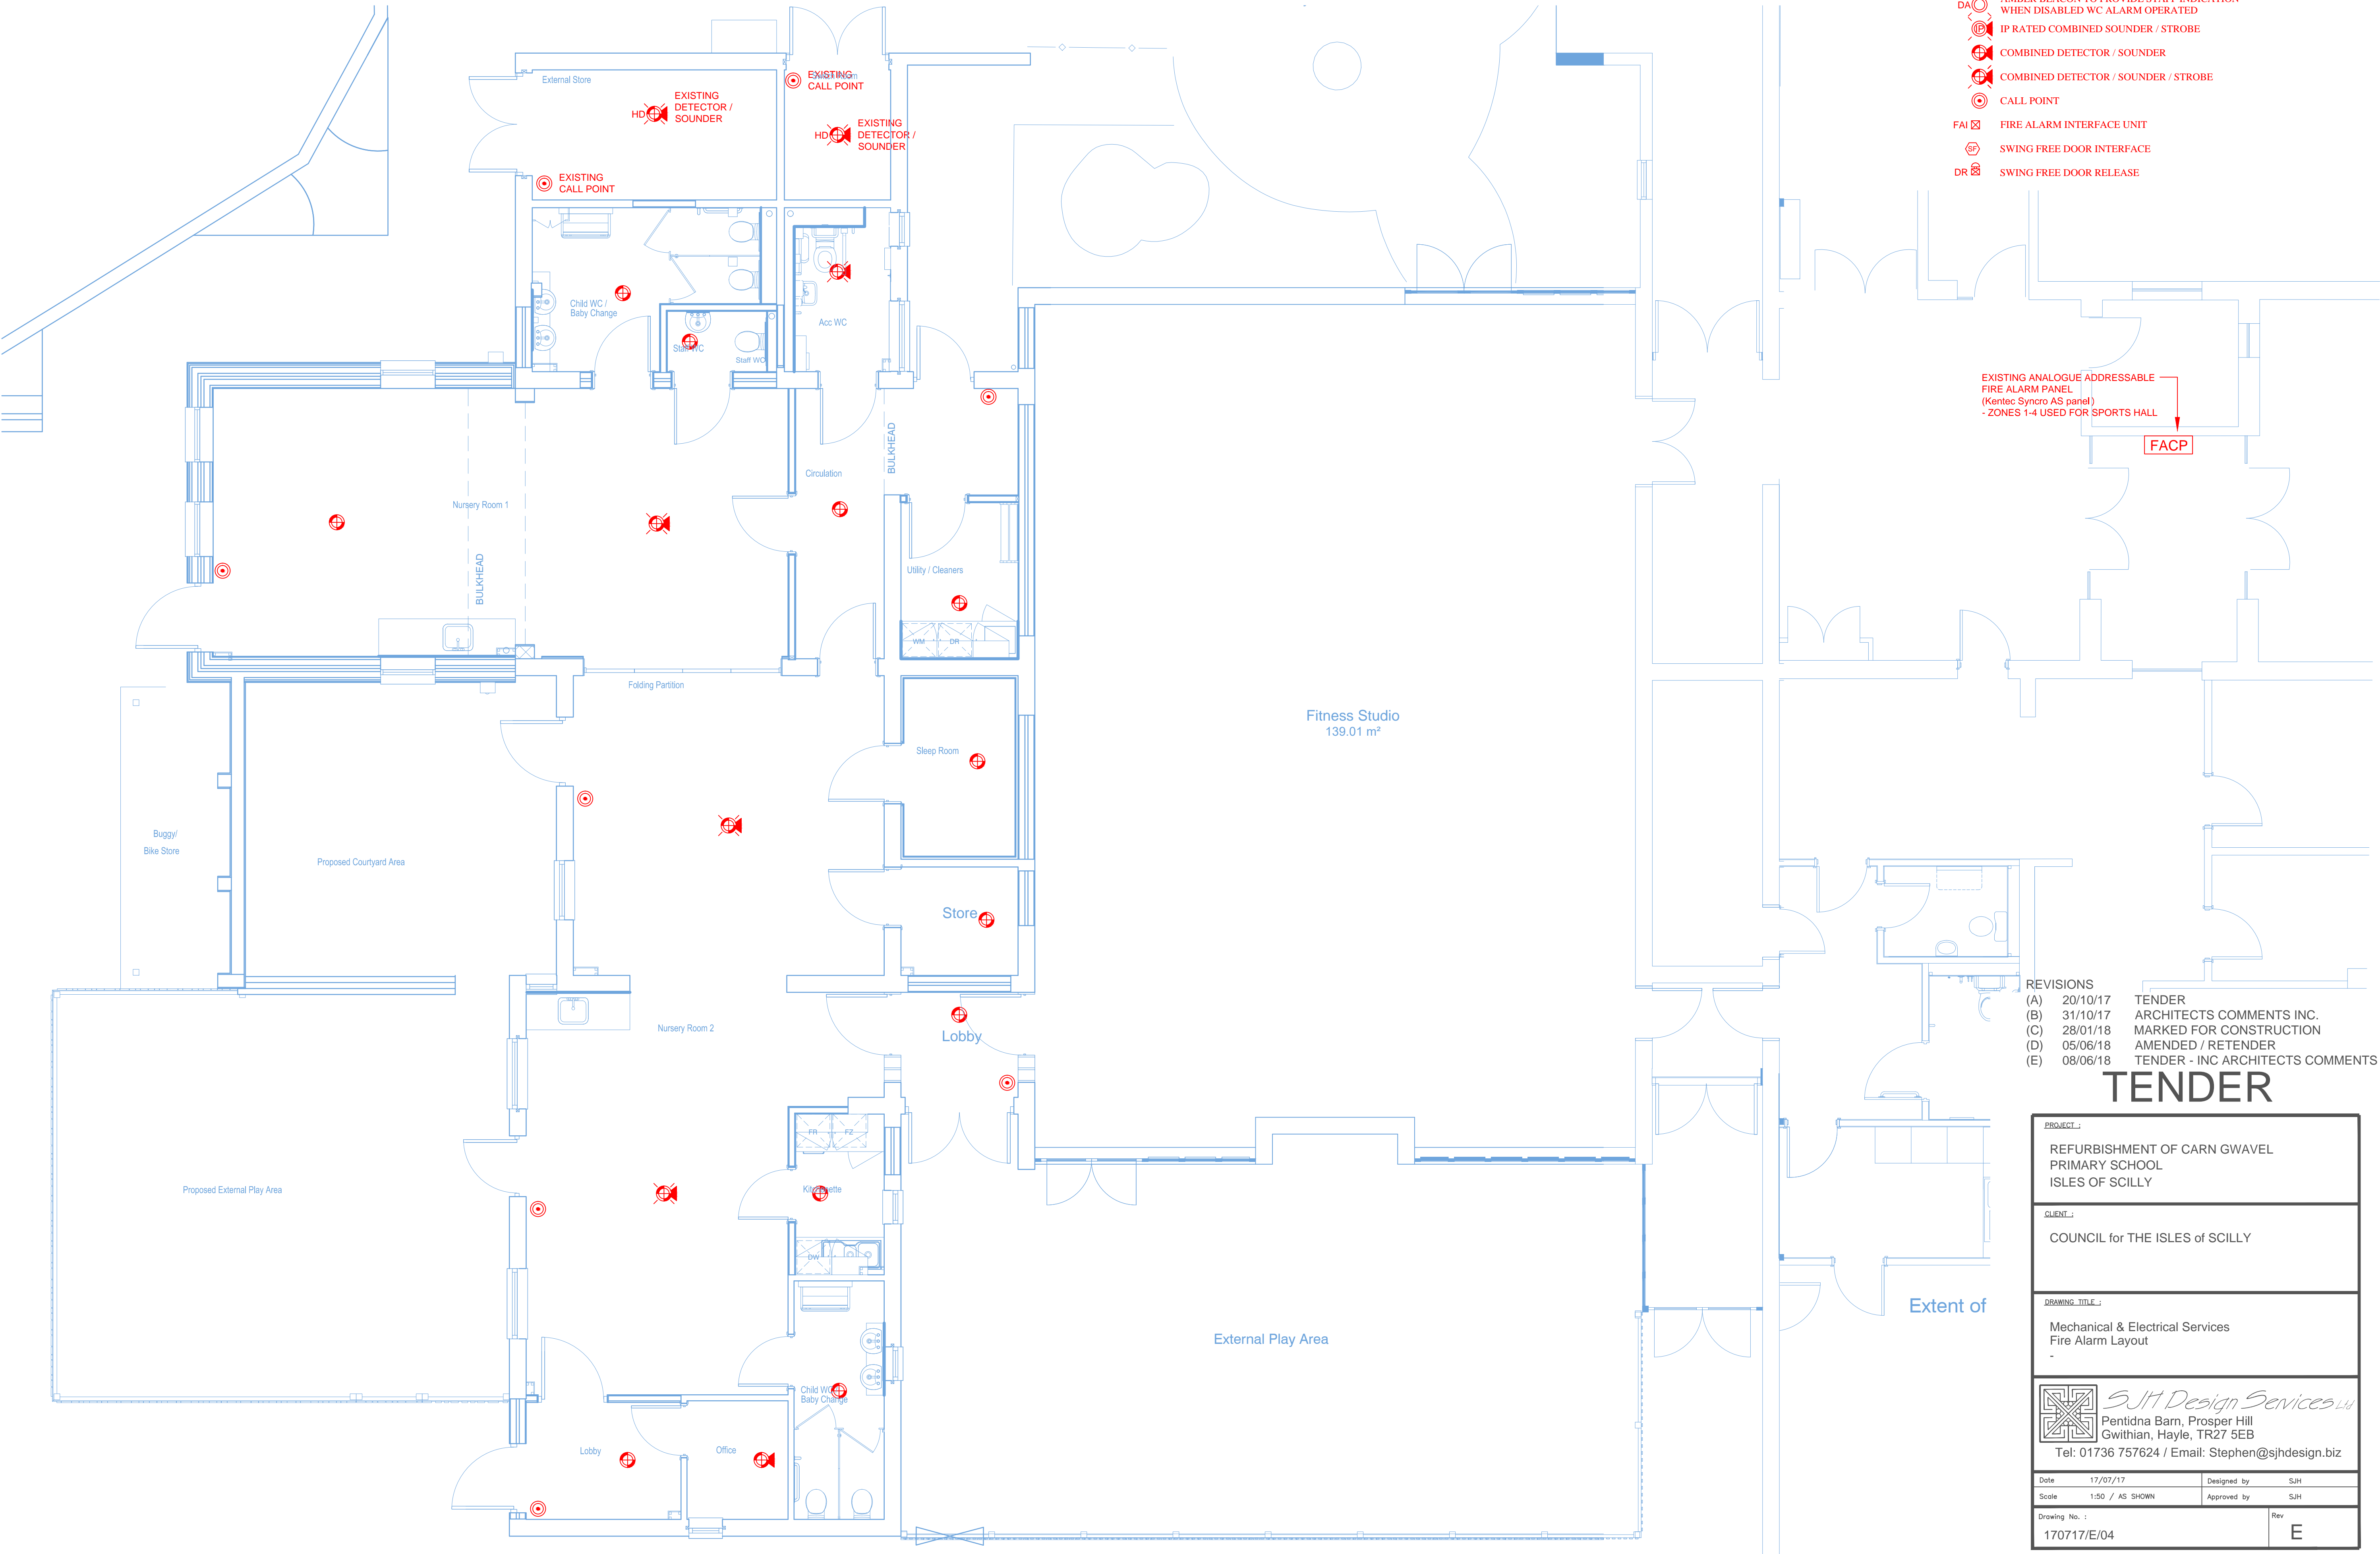

FIRE ALARM SYSTEM

- [FACP] FIRE ALARM CONTROL PANEL
- [SD] SMOKE DETECTOR
- [HD] HEAT DETECTOR
- [ASD] ASPIRATING SMOKE DETECTOR
- [DA] AMBER BEACON TO PROVIDE STAFF INDICATION WHEN DISABLED WC ALARM OPERATED
- [IP] IP RATED COMBINED SOUNDER / STROBE
- [CDS] COMBINED DETECTOR / SOUNDER
- [CDSST] COMBINED DETECTOR / SOUNDER / STROBE
- [CP] CALL POINT
- [FAI] FIRE ALARM INTERFACE UNIT
- [SFD] SWING FREE DOOR INTERFACE
- [DR] SWING FREE DOOR RELEASE

EXISTING ANALOGUE ADDRESSABLE
FIRE ALARM PANEL
(Kentec Syncro AS panel)
- ZONES 1-4 USED FOR SPORTS HALL

FACP

REVISIONS		
(A)	20/10/17	TENDER
(B)	31/10/17	ARCHITECTS COMMENTS INC.
(C)	28/01/18	MARKED FOR CONSTRUCTION
(D)	05/06/18	AMENDED / RETENDER
(E)	08/06/18	TENDER - INC ARCHITECTS COMMENTS

TENDER

PROJECT : REFURBISHMENT OF CARN GWAVEL PRIMARY SCHOOL ISLES OF SCILLY	
CLIENT : COUNCIL for THE ISLES of SCILLY	
DRAWING TITLE : Mechanical & Electrical Services Fire Alarm Layout	
<div><div></div><div><div>SJH Design Services Ltd</div><div>Pentidna Barn, Prosper Hill Gwithian, Hayle, TR27 5EB Tel: 01736 757624 / Email: Stephen@sjhdesign.biz</div></div></div>	
Date 17/07/17	Designed by SJH
Scale 1:50 / AS SHOWN	Approved by SJH
Drawing No. : 170717/E/04	Rev E