


NOTE - THIS DRAWING TO BE READ IN CONJUNCTION WITH: -

- Drg Nos 170717/M/01 - 03 & 170717/E/01 - 04
- M&E Services Schedule of Work

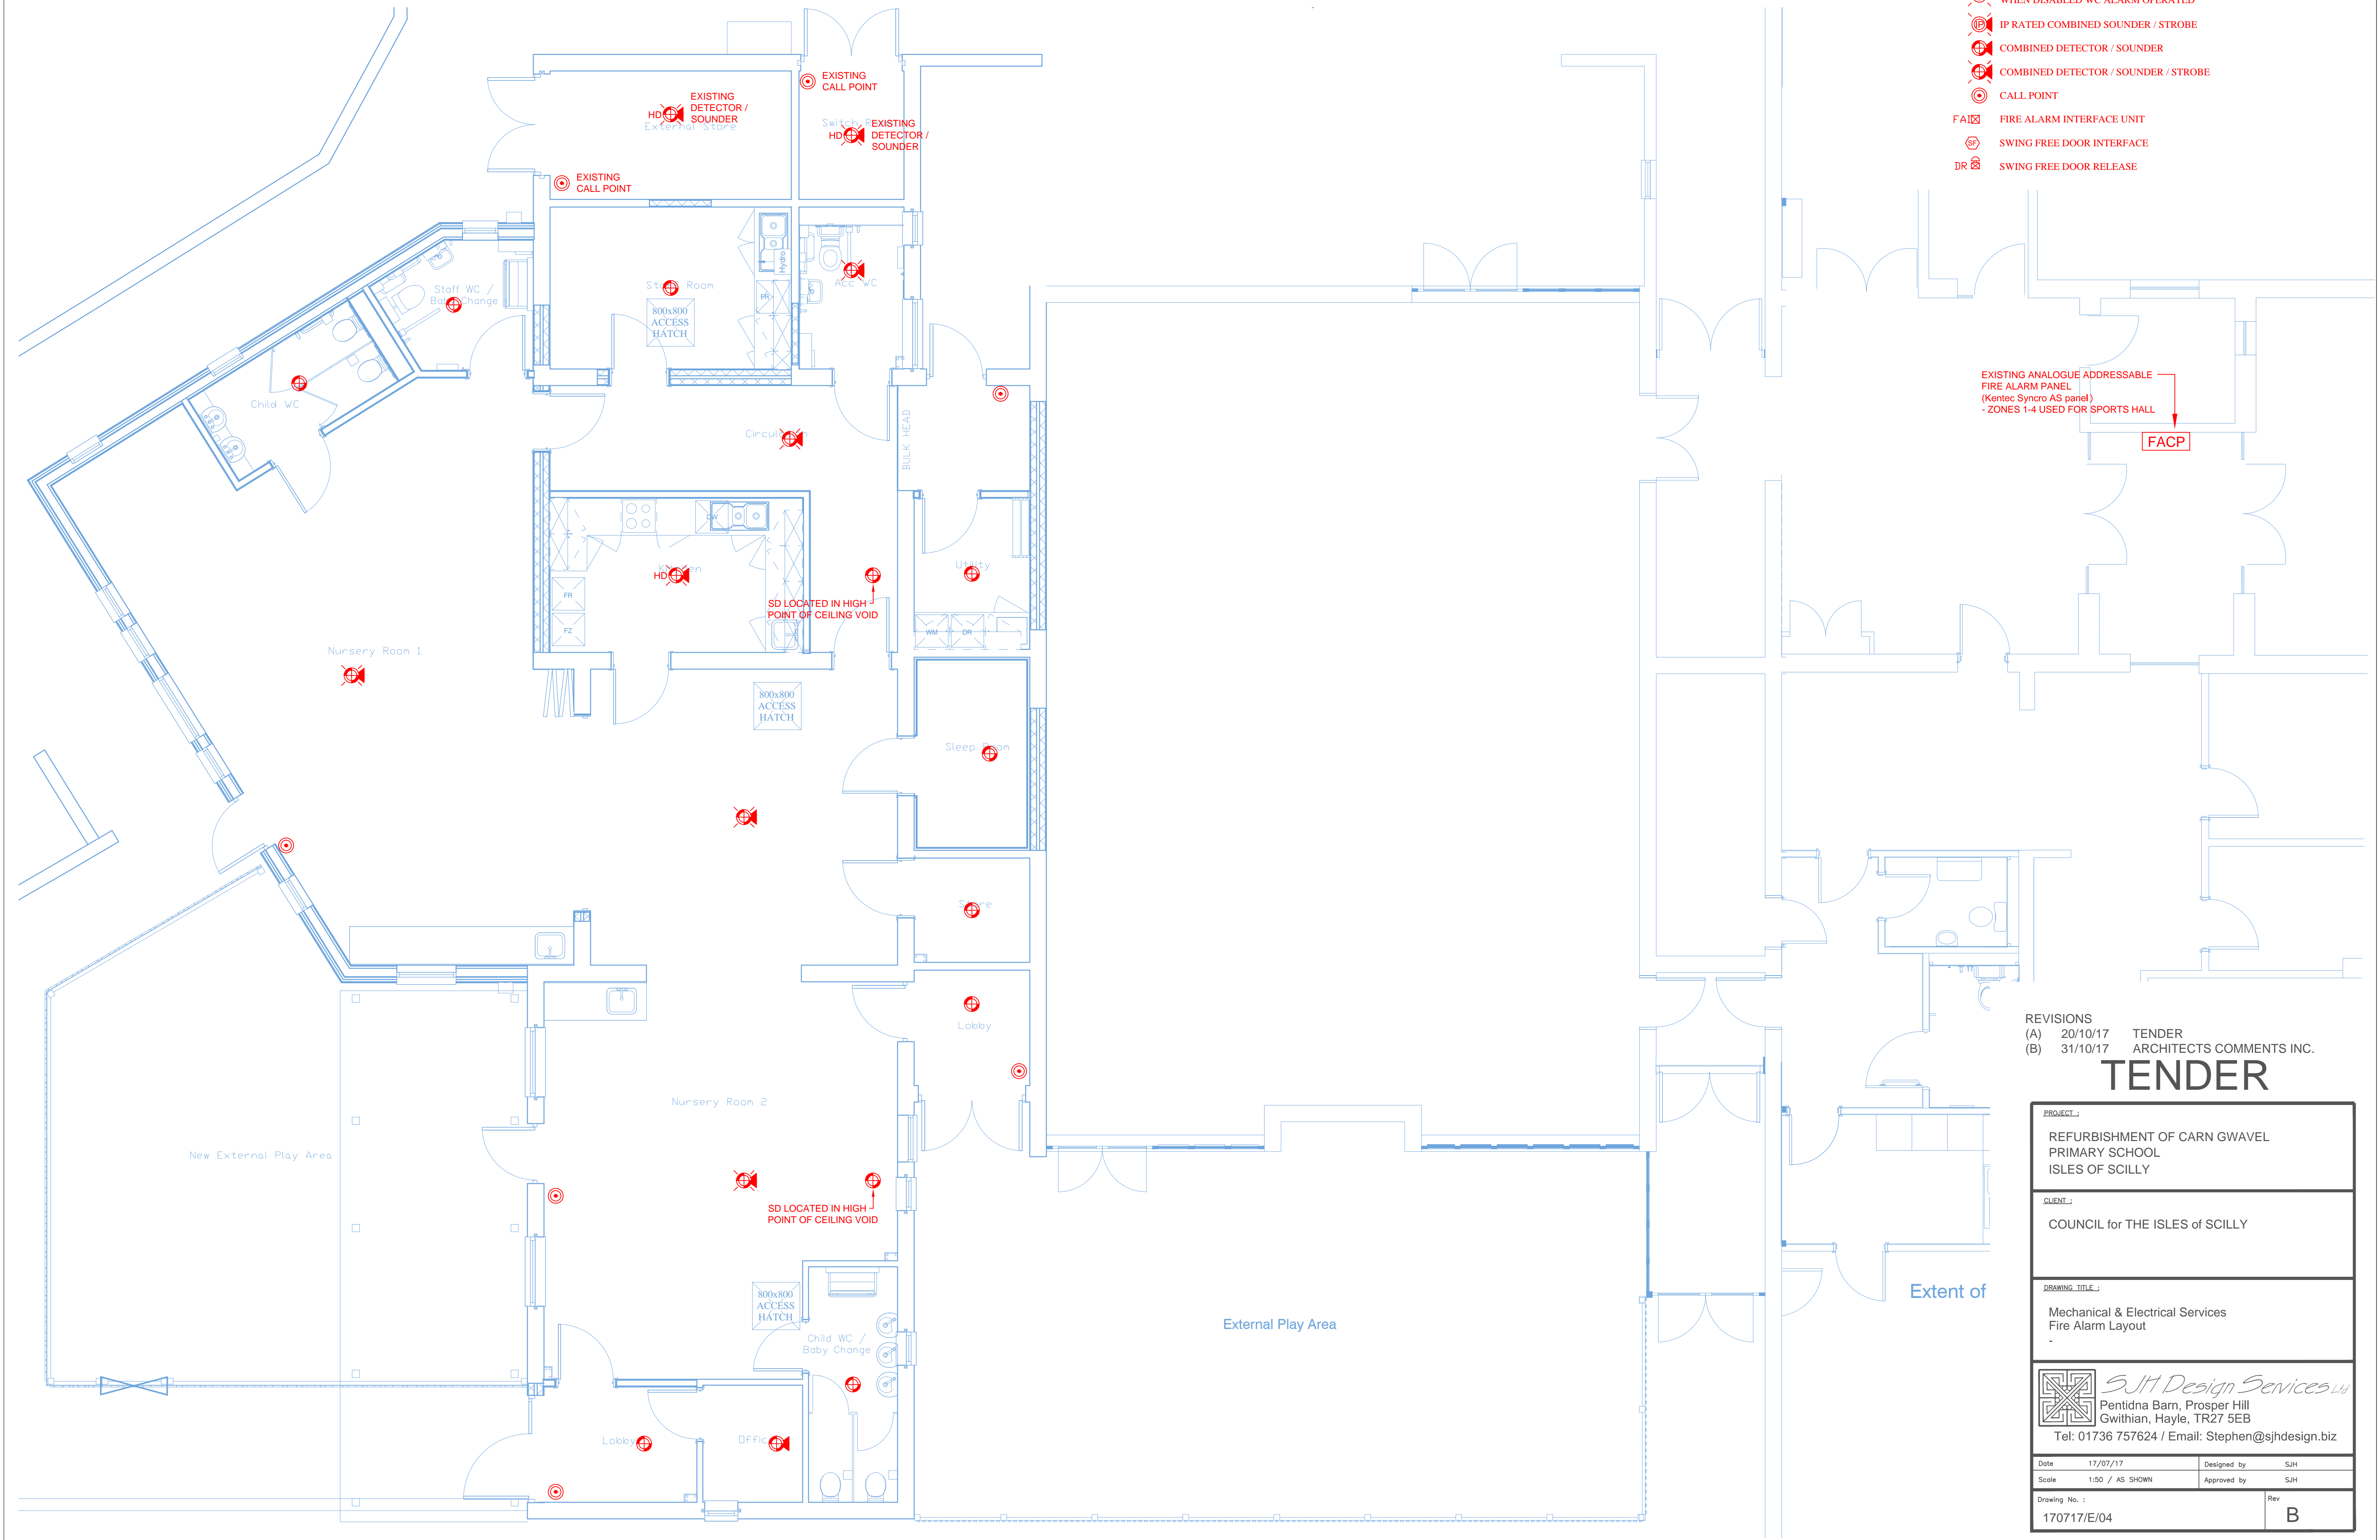

- FIRE ALARM SYSTEM**
- FACP FIRE ALARM CONTROL PANEL
 - SMD SMOKE DETECTOR
 - HD HEAT DETECTOR
 - ASD ASPIRATING SMOKE DETECTOR
 - DA AMBER BEACON TO PROVIDE STAFF INDICATION WHEN DISABLED WC ALARM OPERATED
 - IP IP RATED COMBINED SOUNDER / STROBE
 - CS COMBINED DETECTOR / SOUNDER
 - CS STROBE COMBINED DETECTOR / SOUNDER / STROBE
 - CP CALL POINT
 - FAIU FIRE ALARM INTERFACE UNIT
 - SF SWING FREE DOOR INTERFACE
 - DR SWING FREE DOOR RELEASE

EXISTING ANALOGUE ADDRESSABLE
FIRE ALARM PANEL
(Kentec Syncro AS panel)
- ZONES 1-4 USED FOR SPORTS HALL

FACP

REVISIONS		
(A)	20/10/17	TENDER
(B)	31/10/17	ARCHITECTS COMMENTS INC.

TENDER

PROJECT : REFURBISHMENT OF CARN GWAVEL PRIMARY SCHOOL ISLES OF SCILLY	
CLIENT : COUNCIL for THE ISLES of SCILLY	
DRAWING TITLE : Mechanical & Electrical Services Fire Alarm Layout	
<div><div></div><div><div>SJH Design Services Ltd</div><div>Pentidna Barn, Prosper Hill Gwithian, Hayle, TR27 5EB Tel: 01736 757624 / Email: Stephen@sjhdesign.biz</div></div></div>	
Date 17/07/17	Designed by SJH
Scale 1:50 / AS SHOWN	Approved by SJH
Drawing No. : 170717/E/04	Rev B