


NOTE - THIS DRAWING TO BE READ IN CONJUNCTION WITH:-

- Drg Nos 170717/M/01 - 03 & 170717/E/01 - 04
- M&E Services Schedule of Work

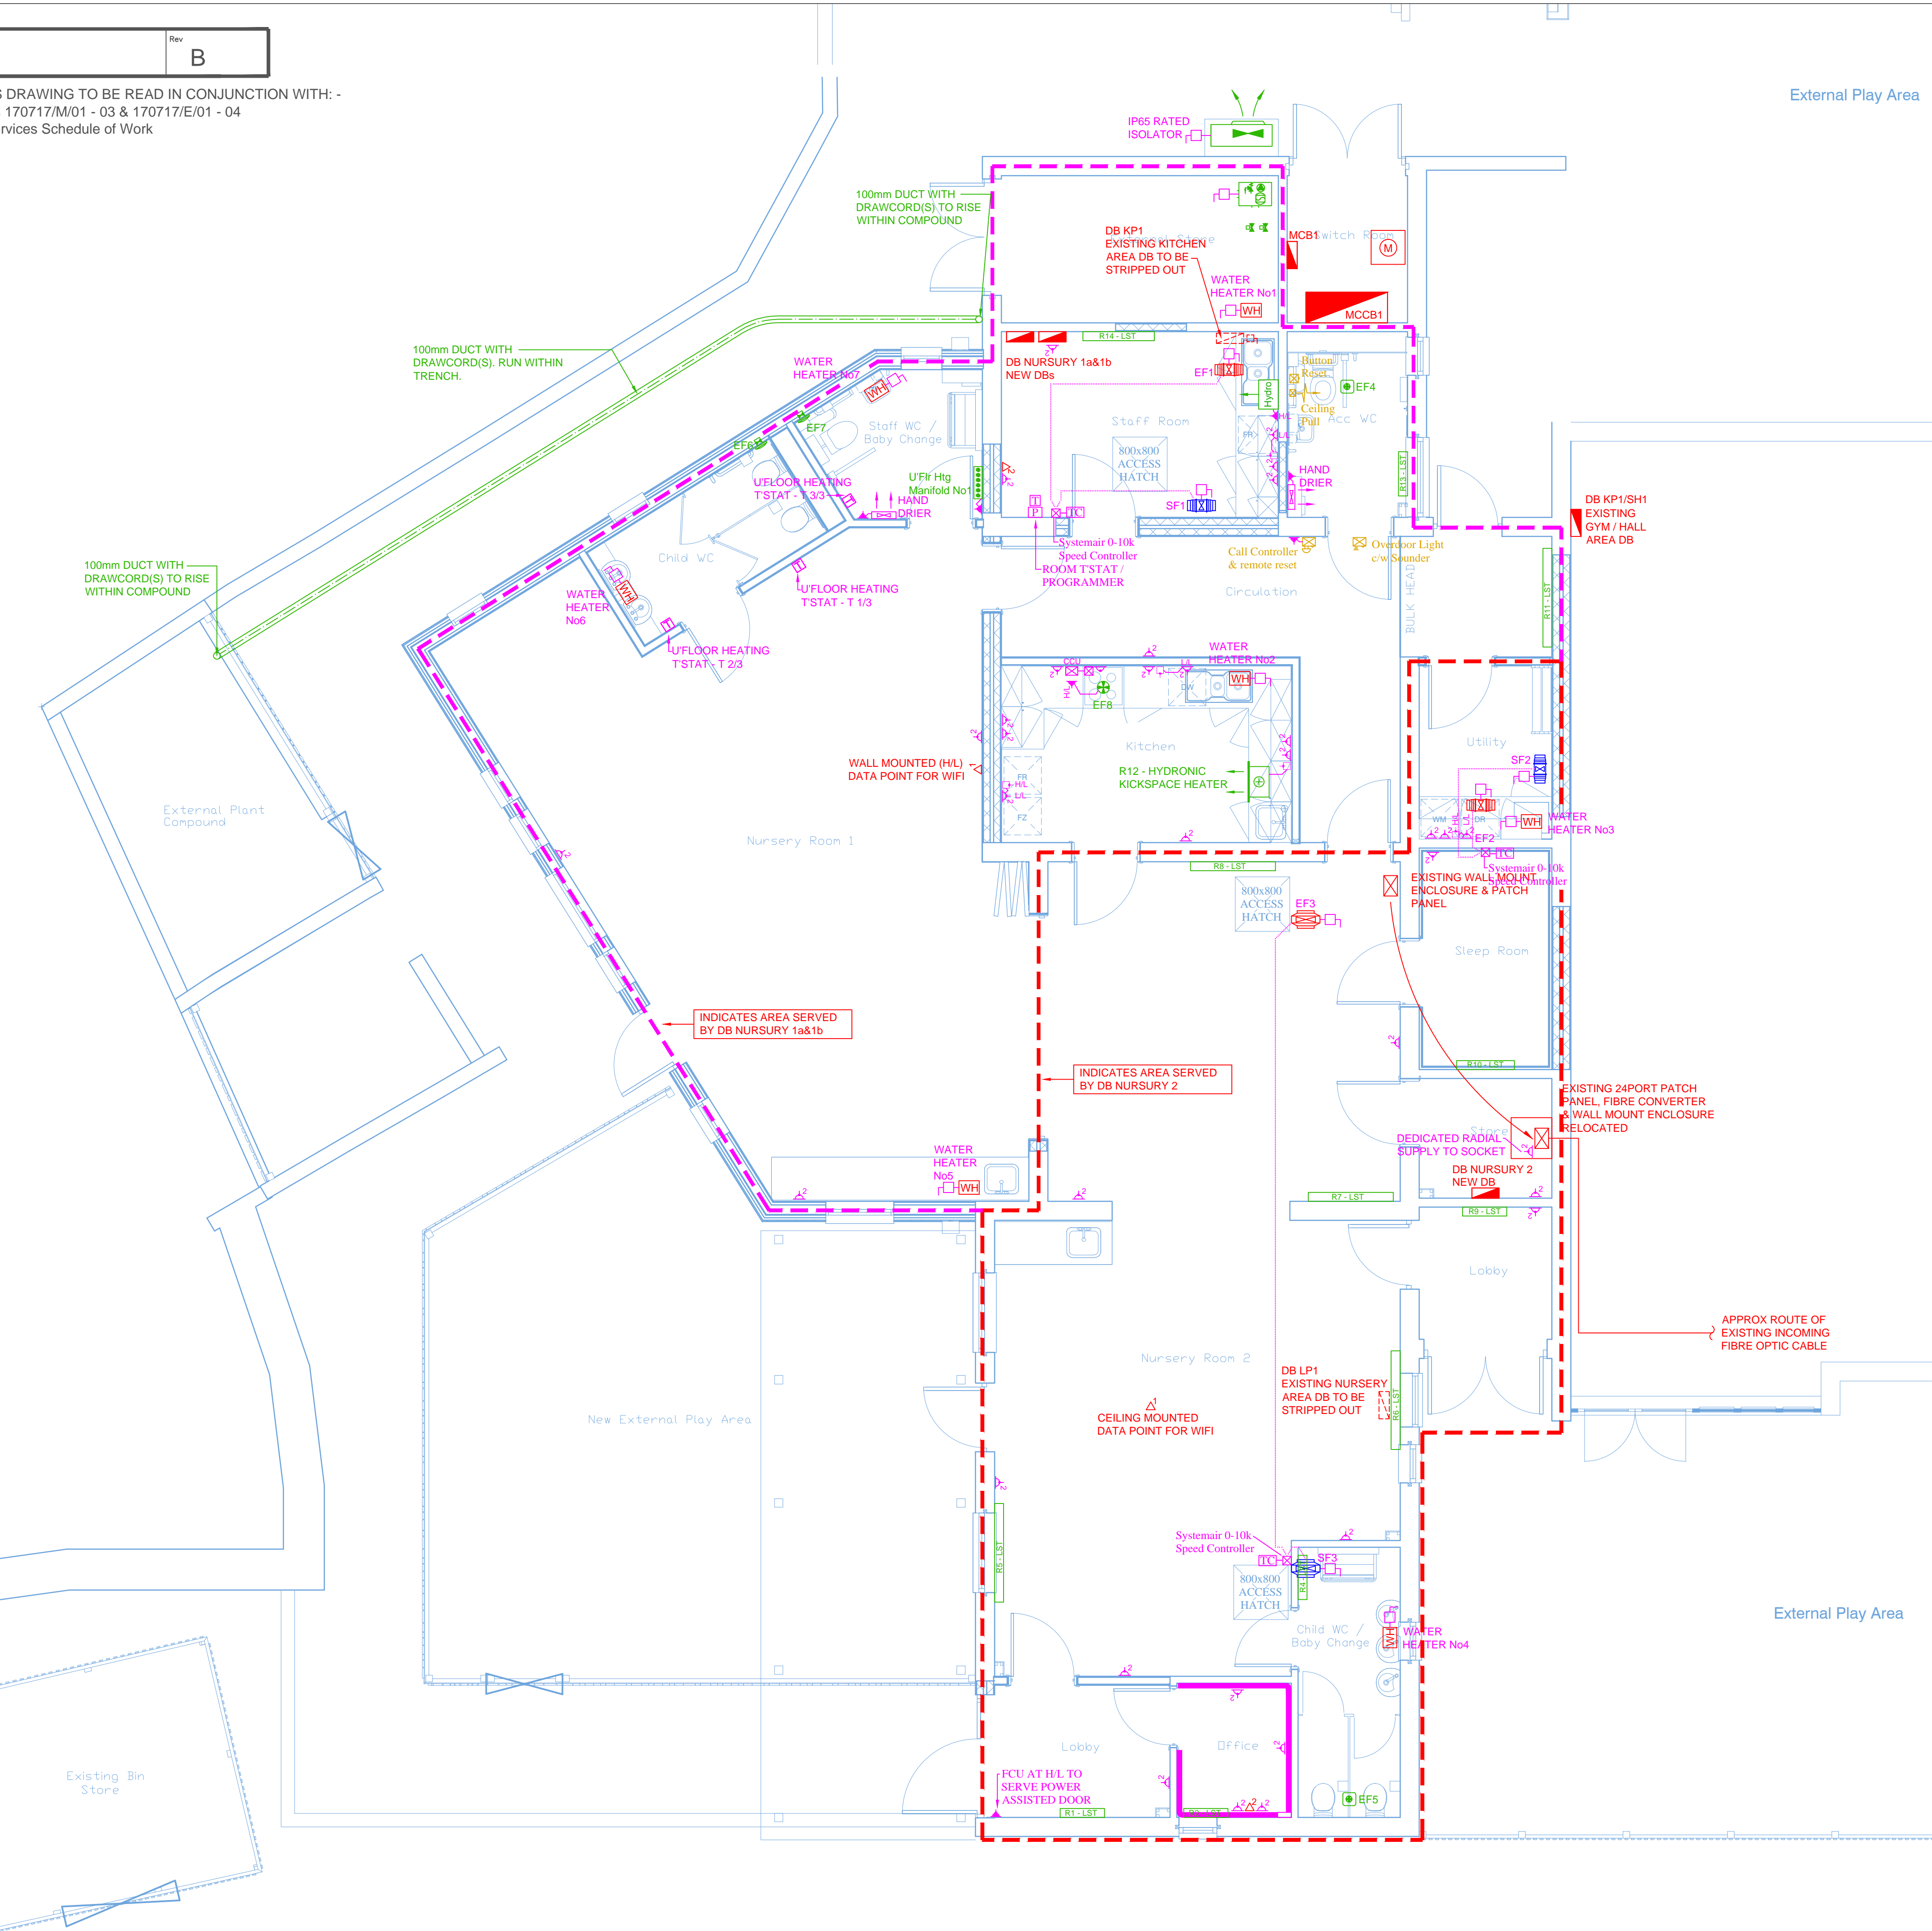

- FAN ISOLATOR

PIR > DANLERS Compact person detector, type COPD

SINGLE 13A SOCKET OUTLET

DOUBLE 13A SOCKET OUTLET

FUSED CONNECTION UNIT

20A DOUBLE POLE SWITCH

FAN ISOLATOR

63A/3P 63A, 3POLE, SWITCH DISCONNECTOR (MK6863)

SHAVER OUTLET

DISTRIBUTION BOARD

COOKER CONTROL, 45A DP MAIN SWITCH (SERVING CONNECTION UNIT AT L/L) & 13A SSO - MK K5060WHI (OR EQUAL).

Dado trunking MK Prestige Compact.

HAND DRIER

TEKFLO EDGE HAND DRYER

SINGLE / DOUBLE DATA OUTLET AS INDICATED

DISABLED PERSONS CALL SYSTEM

- System to be as manufactured by manufactured by C-TEC's, type NC951 comprising:-
- |                                |             |  |
|--------------------------------|-------------|--|
| Call Controller & remote reset | - NC943B    | Single Zone Call Controller                            |
| Overdoor Light c/w Sounder     | - NC806CS   | Overdoor Light c/w Sounder.                            |
| Button Reset                   | - NC809DBBT | Remote Reset Point c/w Sounder.                        |
| Ceiling Pull                   | - NC807C    | Ceiling Pull incorporating a red confidence indicator. |

- REVISIONS
- |     |          |                          |
|-----|----------|--------------------------|
| (A) | 20/10/17 | TENDER                   |
| (B) | 31/10/17 | ARCHITECTS COMMENTS INC. |

TENDER

PROJECT : REFURBISHMENT OF CARN GWAVEL PRIMARY SCHOOL ISLES OF SCILLY	
CLIENT : COUNCIL for THE ISLES of SCILLY	
DRAWING TITLE : Mechanical & Electrical Services Power, Data & Nurse Call Layouts	
<div><div></div><div><div>SJH Design Services Ltd</div><div>Pentidna Barn, Prosper Hill Gwithian, Hayle, TR27 5EB Tel: 01736 757624 / Email: Stephen@sjhdesign.biz</div></div></div>	
Date 17/07/17	Designed by SJH
Scale 1:50 / AS SHOWN	Approved by SJH
Drawing No. : 170717/E/01	Rev B